



# FIRESTOP CENTRE

Authorised New Zealand Distributor  
Ph (09) 483 4000 www.firestopcentre.co.nz


## AGNI-Seal in 1x13mm P'bd Wall or 90mm Concrete Wall Copper or Steel Pipe (32mm - 150mm diam) FRR -/60/-

Page 1 of 2

### Step-by-step installation instructions:

1. Ensure the aperture is free from dust and debris.
2. Apply AGNI-Seal into the annular gap around the service to the full depth of the lining.
3. Apply 30mm x 30mm AGNI-Seal fillet/cone around the service.

System ID# FC247

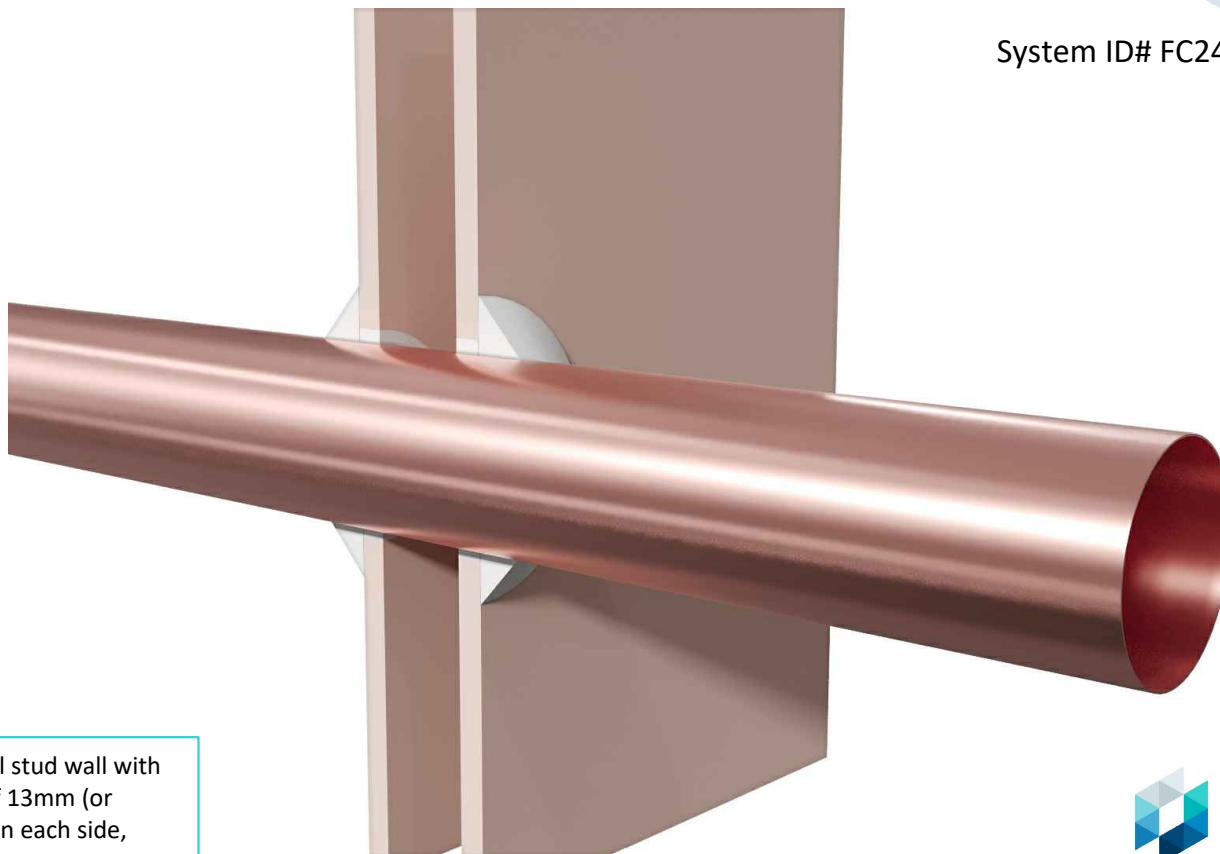

**NOTE:** Tested all sizes with copper pipes. Steel pipes approved by virtue of AS1530.4 clause 10.12.3.2

### Technical Information

Substrate	<ul style="list-style-type: none"><li>• Min. 64mm timber or steel stud wall with a minimum of one layer of 13mm (or greater) FR plasterboard on each side, with or without insulation.</li><li>• Min. 90mm concrete /masonry wall</li></ul>
Service range	Up to DN150mm copper/steel pipes
Annular gap	DN32mm - 9.5 - 11.5mm DN100mm - 6 - 9mm DN150mm - 8 - 9.5mm
AGNI-Products	AGNI-Seal
Protection installation	From both sides of the wall

### Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/60/-
Reference	PF24026



8 Clare St Bayswater  
VIC 3153, AUSTRALIA  
www.agnitek.com.au

#### Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date 03.04.2025




# FIRESTOP CENTRE

Authorised New Zealand Distributor  
Ph (09) 483 4000 www.firestopcentre.co.nz

## AGNI-Seal in 1x13mm P'bd Wall or 90mm Concrete Wall Copper or Steel Pipe (32mm - 150mm diam) FRR -/60/-

Page 2 of 2

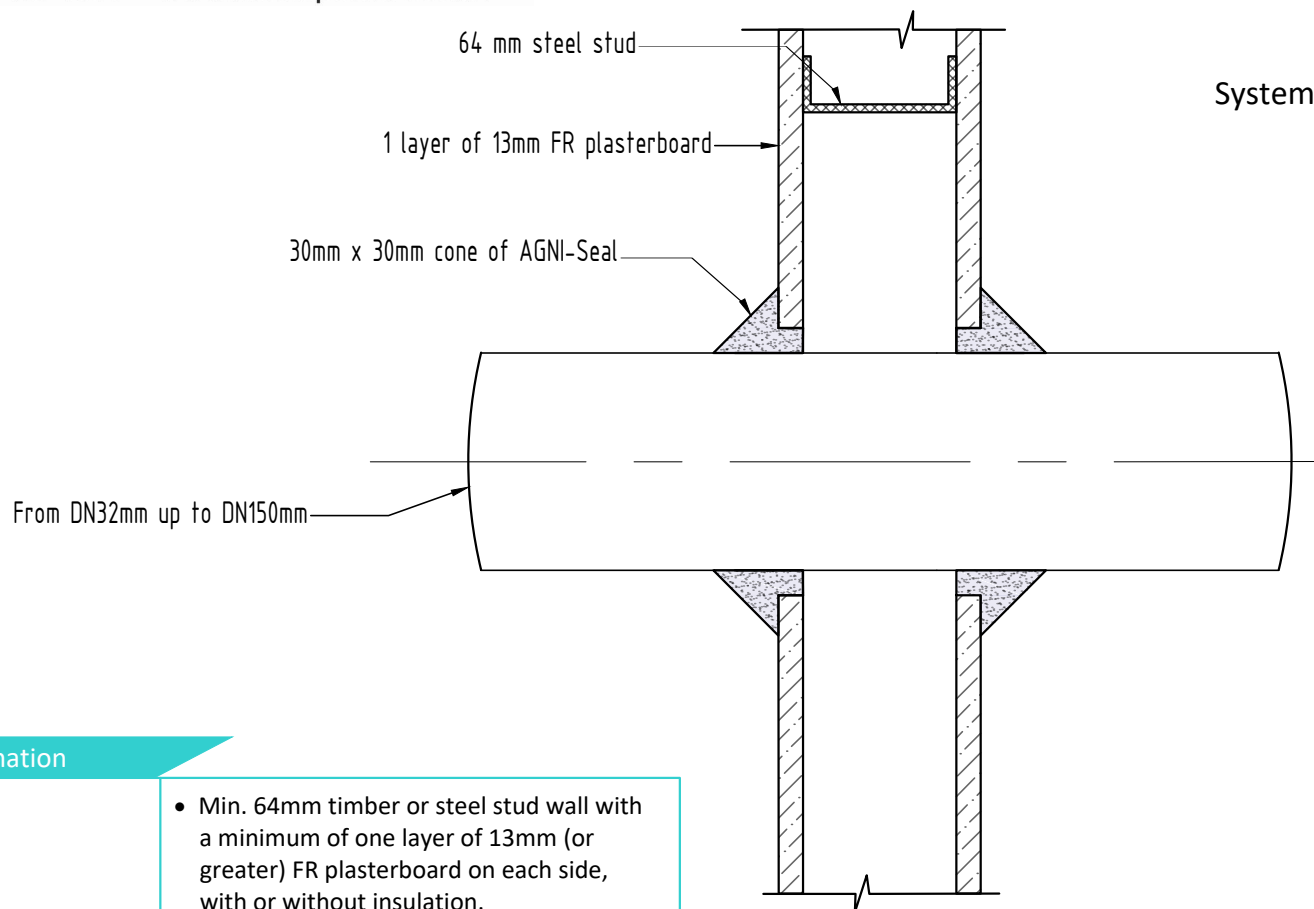

### Technical Information

Substrate	<ul style="list-style-type: none"><li>• Min. 64mm timber or steel stud wall with a minimum of one layer of 13mm (or greater) FR plasterboard on each side, with or without insulation.</li><li>• Min. 90mm concrete /masonry wall</li></ul>
Service range	Up to DN150mm copper/steel pipes
Annular gap	DN32mm - 9.5 - 11.5mm DN100mm - 6 - 9mm DN150mm - 8 - 9.5mm
AGNI-Products	AGNI-Seal
Protection installation	From both sides of the wall

### Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/60/-
Reference	PF24026



8 Clare St Bayswater  
VIC 3153, AUSTRALIA  
www.agnitek.com.au

#### Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date 03.04.2025