



# FIRESTOP CENTRE

Authorised New Zealand Distributor  
Ph (09) 483 4000 www.firestopcentre.co.nz

## AGNI-Sleeve in 2 x 13mm Plasterboard Wall or 116mm Concrete/Masonry/Block Wall Fibre Optic Cable (9.6mm) FRR -/120/120

System ID# FC540

Page 1 of 2

### Step-by-step installation instructions:

1. Apply AGNI-Seal into the annular gap to the full depth of the lining, 26mm (nominal) deep.
2. Apply 20mm x 20mm AGNI-Seal fillet/cone around the cable.



### Technical Information

|                         |  |
|-------------------------|--|
| Substrate               | <ul style="list-style-type: none"><li>• Min. 64mm timber or steel stud wall with a minimum of two layers of 13mm (or greater) FR plasterboard on each side, with or without insulation.</li><li>• Min. 116mm concrete wall</li></ul> |
| Service range           | 9.6mm Optic cable  |
| Annular gap             | 2.8 - 4.2mm  |
| AGNI-Products           | AGNI-Seal  |
| Protection installation | From both sides of the wall  |

### Compliance Information

|           |                              |
|-----------|------------------------------|
| Standards | AS1530.4-2014, AS4072.1-2005 |
| FRR/FRL   | -/120/120                    |
| Reference | RIRF25005                    |
|           |                              |
|           |                              |



**Agnitek**  
FIRE RATED TECHNOLOGY

8 Clare St Bayswater  
VIC 3153, AUSTRALIA  
www.agnitek.com.au

#### Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.


|      |            |
|------|------------|
| Date | 03.04.2025 |
|------|------------|



# FIRESTOP CENTRE

Authorised New Zealand Distributor  
Ph (09) 483 4000 [www.firestopcentre.co.nz](http://www.firestopcentre.co.nz)

System ID# FC540

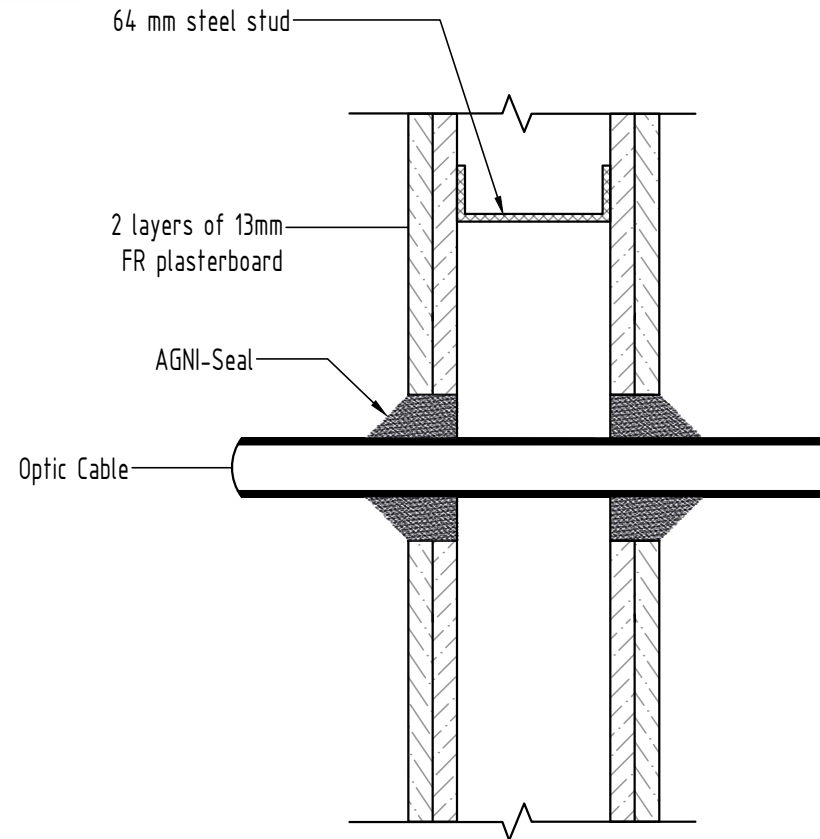

## Technical Information

|                         |  |
|-------------------------|--|
| Substrate               | <ul style="list-style-type: none"><li>• Min. 64mm timber or steel stud wall with a minimum of two layers of 13mm (or greater) FR plasterboard on each side, with or without insulation.</li><li>• Min. 116mm concrete wall</li></ul> |
| Service range           | 9.6mm Optic cable  |
| Annular gap             | 2.8 - 4.2mm  |
| AGNI-Products           | AGNI-Seal  |
| Protection installation | From both sides of the wall  |

## Compliance Information

|           |                              |
|-----------|------------------------------|
| Standards | AS1530.4-2014, AS4072.1-2005 |
| FRR/FRL   | -/120/120                    |
| Reference | RIRF25005                    |
|           |                              |
|           |                              |



8 Clare St Bayswater  
VIC 3153, AUSTRALIA  
[www.agnitek.com.au](http://www.agnitek.com.au)

### Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

|      |            |
|------|------------|
| Date | 03.04.2025 |
|------|------------|