

FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz


AGNI-Seal in 2 x 13mm Plasterboard Wall or 116mm Concrete/Masonry/Block Wall
Data Cables (up to 13)
Max FRR -/120/120 System ID# FC830

Step-by-step installation instructions:

Ensure the aperture is clean.

Fill the aperture with 26mm (nominal) deep AGNI-Seal (to the full depth of the lining).

Install a 30mm x 30mm cone of AGNI-Seal cable bundle each side of the wall.

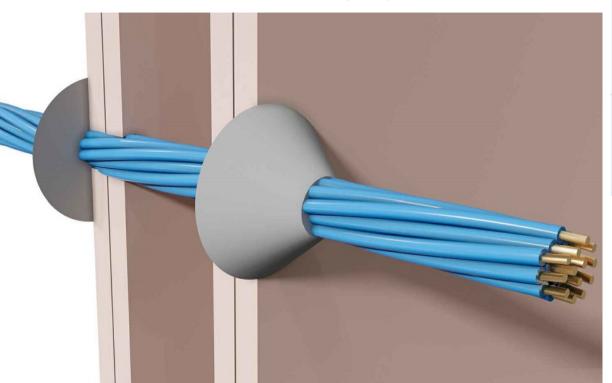

Technical Information

Substrate	 Min. 64mm steel or timber stud wall with a minimum of two layers of 13mm (or greater) FR plasterboard on each side, with or without insulation. Min. 116mm concrete wall 	
Service type	Cable bundle of up to 13x data cables	
Annular gap	Min: 3.5mm, Max: 13mm	
AGNI-Products	AGNI-Seal	
Protection installation	Both sides of the wall	

Comp	llance	Informa	ation
COILIP	marice		ation

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	RIRF24016



8 Clare St Bayswater VIC 3153, AUSTRALIA www.agnitek.com.au

Disclaime

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date


08.04.2024



FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

AGNI-Seal in 2 x 13mm Plasterboard Wall or 116mm Concrete/Masonry/Block Wall Data Cables (up to 13) Max FRR -/120/120

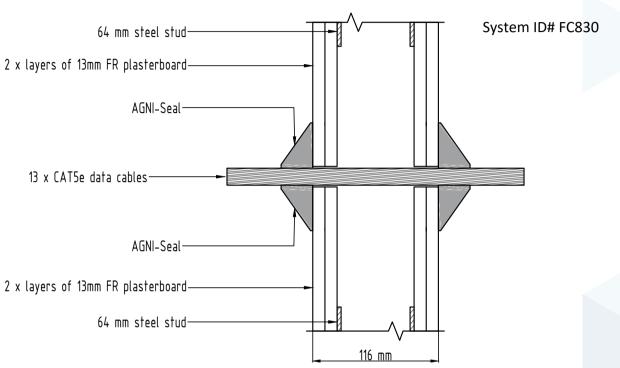

nnical	Intormation

Substrate	 Min. 64mm steel or timber stud wall with a minimum of two layers of 13mm (or greater) FR plasterboard on each side, with or without insulation. Min. 116mm concrete wall
Service type	Cable bundle of up to 13x data cables
Annular gap	Min: 3.5mm, Max: 13mm
AGNI-Products	AGNI-Seal
Protection installation	Both sides of the wall

(nmi	nliance	Information
COIII	Jilarice	miormation

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/120/120
Reference	RIRF24016



8 Clare St Bayswater VIC 3153, AUSTRALIA www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date 08.04.2024