



AGNI-Sleeve in 190mm Concrete Floor/Ceiling Up to 100mm PVC-U Pipe, Top Fix FRR -/360/360

Step-by-step installation instructions:

1. Ensure the aperture is free from dust and debris.
2. Cut AGNI-Sleeve to 240mm wide (190mm for the protection within the concrete floor/ceiling and 50mm for fixing tabs) to fit one revolution of AGNI-Sleeve into the aperture.
3. Cut AGNI-Sleeve to make two 50mm high x 25mm wide fixing tabs.
4. Insert the AGNI-Sleeve into the aperture flush with the concrete floor / ceiling surface.
5. Leave the tabs remained past the face of the concrete floor / ceiling surface.
6. Bend the fixing tabs over onto the surface of the floor/ceiling and secure them using concrete anchors.
7. Apply a bead of AGNI-Seal (10mm nominal) between the floor/ ceiling, AGNI-Sleeve and the pipe, finishing flush with the face of the floor/ceiling.

System ID# FC857



Technical Information

Substrate	Min. 190mm concrete ceiling/floor
Service range	Up to 100mm PVC-U pipes
Annular gap	5-9mm
AGNI-Products	AGNI-Sleeve, AGNI-Seal
Protection installation	Asymmetrical (installed from above the floor/ceiling)

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/360/360
Reference	RIRF24096 (AP-109)




8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date 20.06.2024

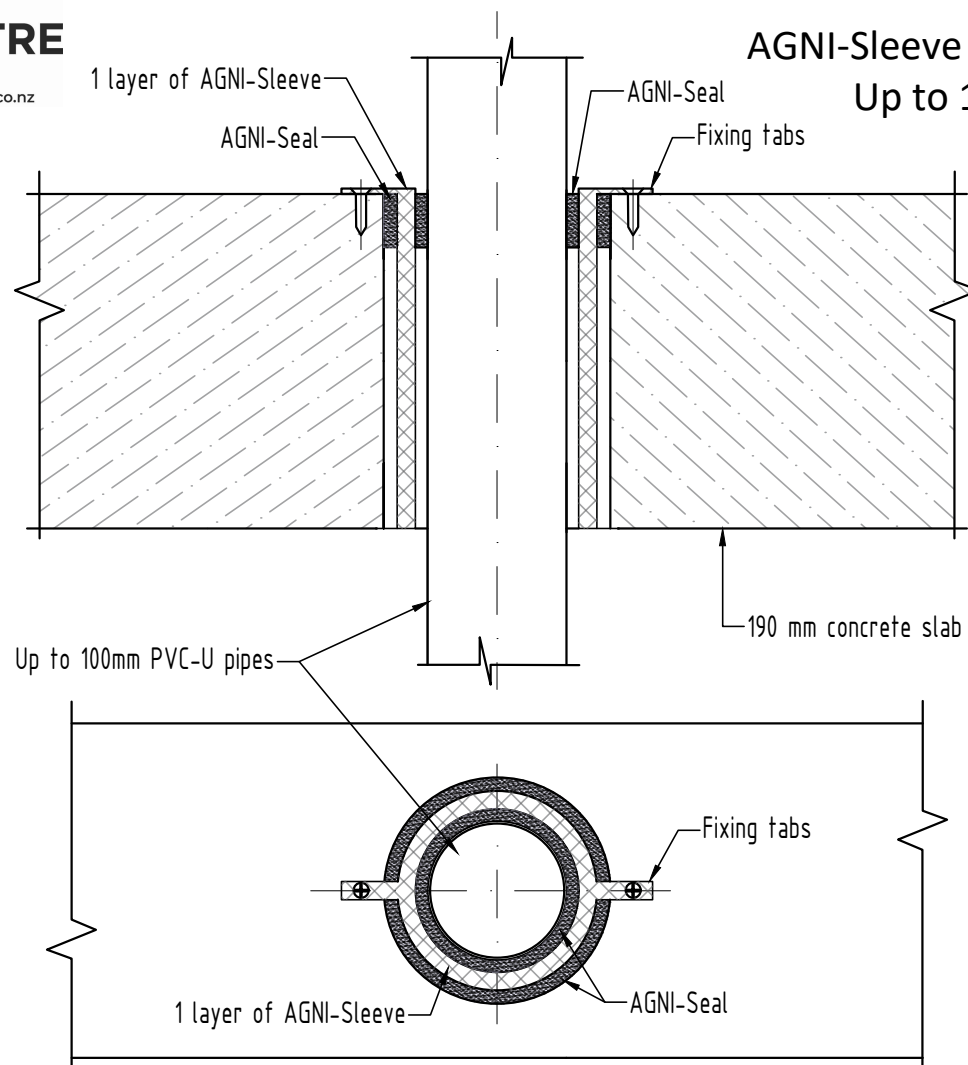

AGNI-Sleeve in 190mm Concrete Floor/Ceiling

Up to 100mm PVC-U Pipe, Top Fix

FRR -/360/360

System ID# FC857

Technical Information

Substrate	Min. 190mm concrete ceiling/floor
Service range	Up to 100mm PVC-U pipes
Annular gap	5-9mm
AGNI-Products	AGNI-Sleeve, AGNI-Seal
Protection installation	Asymmetrical (installed from above the floor/ceiling)

Compliance Information

Standards	AS1530.4-2014, AS4072.1-2005
FRR/FRL	-/360/360
Reference	RIRF24096 (AP-109)



Agnitek
FIRE RATED TECHNOLOGY

8 Clare St Bayswater
VIC 3153, AUSTRALIA
www.agnitek.com.au

Disclaimer

Agnitek reserves the right to modify product specifications without prior notice due to its ongoing research, development & certification programme. The information in this document is provided in good faith and is intended for guidance purposes only. Any accompanying drawings are solely for illustrative purposes. Since Agnitek cannot oversee installation methods or ensure site conditions, no warranties, expressed or implied, are intended regarding the products' actual performance. We do not accept liability for any loss, damage, or injury from using this information. Please take a look at the test reports displayed on a relevant AGNI-System webpage for all compliance specifics.

Date 20.06.2024