




FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

Allproof Low Profile Fire Collar Cables (power and data) through a 110mm CLT Wall

INSTALLATION INSTRUCTIONS:

1. Ensure substrate around the service is flat and free from obstructions.
2. Seal the annular space between the wall and the service with Allproof MAS310 fire sealant to a depth of at least 13mm. Where annular space is greater than 4mm insert a PE backing rod prior to sealing.
3. Open pipe collar and position around the service.
4. Slide tab through slot in pipe collar and fold back 180° to secure.
5. Secure collar using Tek screws 12G x 50mm

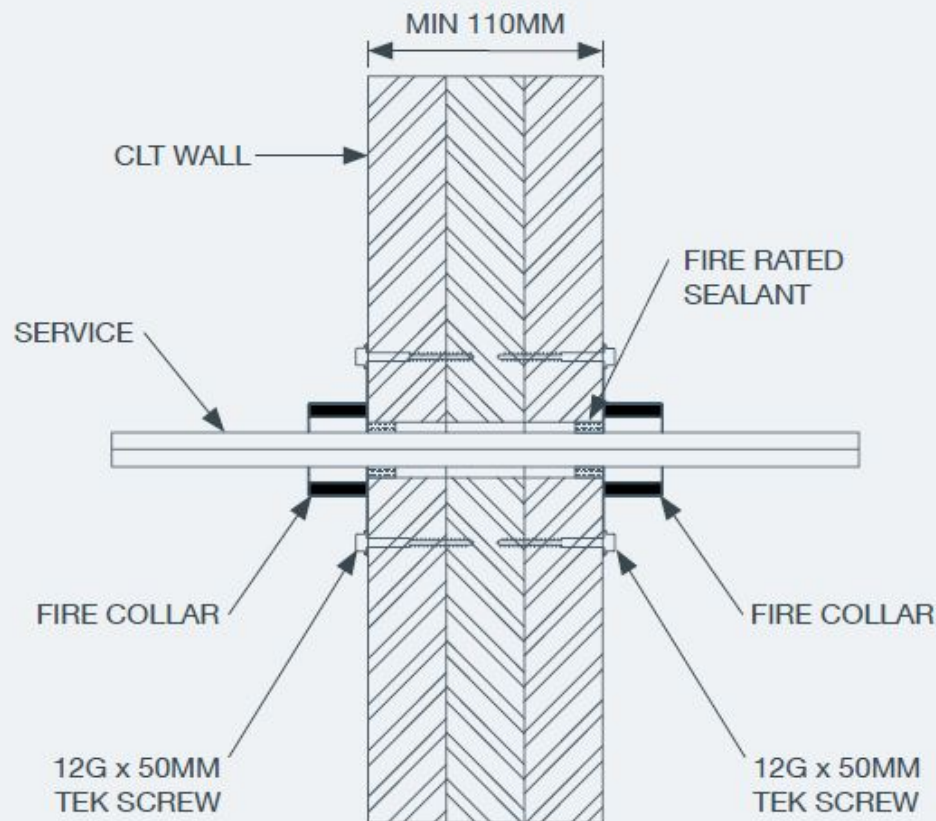

BRANZ Appraised
Appraisal No.1088 [2019]

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Firestop Centre has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on www.firestopcentre.co.nz

Signed and approved:



BRANZ Appraisal 1008
Technical Manual - Electrical Pg 11
AS1530.4-2014 AS4072.1-2005

System ID# FC293

Products	Allproof Low-Profile Fire Collar
Application	Fire stopping of cables in CLT walls
Construction	Minimum wall thickness 110mm CLT

Fire Classification:

TPS (up to 7 cables) with 25mm collar and hole size 26-32mm FRR -/60/60

Data (up to 10 CAT6 data cables) with 25mm collar and hole size 26-32mm FRR -/60/60

Mains cable (up to 25mm) plus 10mm Earth cable with 25mm collar and hole size 30-35mm FRR -/60/60

ALLPROOF

INDUSTRIES

Allproof Industries Ltd
17 Bay Park Place
Beach Haven, AK 0626

Sheet size: A4	Drawn date & no: 28/5/25
Scale: NTS	Drawn by: G.P