




FIRESTOP CENTRE

Authorised New Zealand Distributor
Ph (09) 483 4000 www.firestopcentre.co.nz

Allproof Drop-In Fire Collar PVC Floor Waste in 110mm CLT Floor

INSTALLATION INSTRUCTIONS:

1. Core drill hole to specified diameter to suit pipe size.
2. Install drop-in fire collar, fixing with two 8Gx25mm pan head screws.
3. Ensure collar on underside of floor is exposed by a nominal 50mm. (Smallest waste (50mm) requires only 20mm collar exposure).
4. No sealant required.

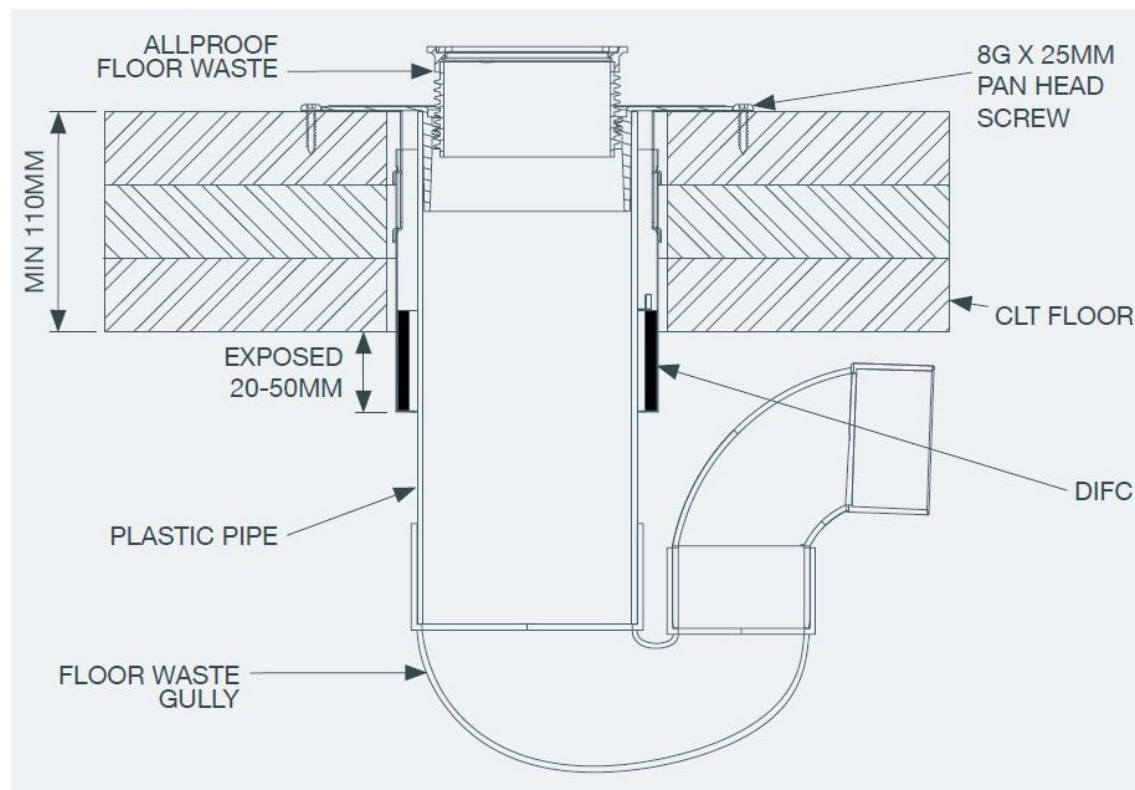

BRANZ Appraised
Appraisal No.1088 [2019]

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Firestop Centre has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specified please refer to the technical data sheets that can be found on www.firestopcentre.co.nz

Signed and approved:



BRANZ Appraisal 1008
Technical Manual - Plumbing Pg 46
AS1530.4-2014 AS4072.1-2005

System ID# FC554

Products	Allproof Drop-In Fire Collar
Application	Fire stopping of floor wastes in CLT floors
Construction	Minimum floor thickness of 110mm and comprise CLT laminated timber

Fire Classification:

PVC 100mm diam floor waste through a 142mm hole

FRR -/60/-

PVC 80mm diam floor waste through a 112mm hole

FRR -/60/60

PVC 50mm diam floor waste through a 88mm hole (this smaller waste requires only 20mm of the collar to be exposed beneath the floor).

FRR -/60/60

ALLPROOF INDUSTRIES

Allproof Industries Ltd
17 Bay Park Place
Beach Haven, AK 0626

Sheet size: A4	Drawn date & no: 28/5/25
Scale: NTS	Drawn by: G.P