FIRESTOP CENTRE Protecta FR Collar Cable Bundles in Plasterboard Walls INNOVATIVE FIRESTOP SOLUTIONS Authorised New Zealand Distributor

warringtonfire

FAS 190125 Pages 37, 8, 9 AS1530.4-2014 AS4072.1-2005

System/FPA Register ID# FC434


## Installation Instructions

ETA 21/0070

1. For sealing cables, a Protecta FR Collar is installed on both sides of the wall.

Ph (09) 483 4000 www.firestopcentre.co.nz

- 2. Before fitting the collar ensure that any gaps between the cables and the separating element are sealed. Gaps between the cables and the construction below 8mm must have a bead of Protecta FR Acrylic to cover the opening, and for gaps 8mm or above, the seal must be plugged with FR Acrylic to the depth of the plasterboard.
- 3. Place a collar around the cables and ensure that the fixing lugs are positioned tightly to the surface of the wall so that the anchors/fixings can be inserted fully.
- 4. Where the surface is uneven, apply a sealing bead of Protecta<sup>®</sup> FR Acrylic between the wall and the collar.
- 5. Attach the collar with steel screws, anchors or fixings that are suitable for the number of boards that form the wall.
- 6. On sites where the penetration size is greater than the cable diameter and/or the cables are on an angle an oversized collar can be used. Protecta® FR Collars are tested 'oversize'. i.e. the internal diameter of the collar can be larger than the cables.

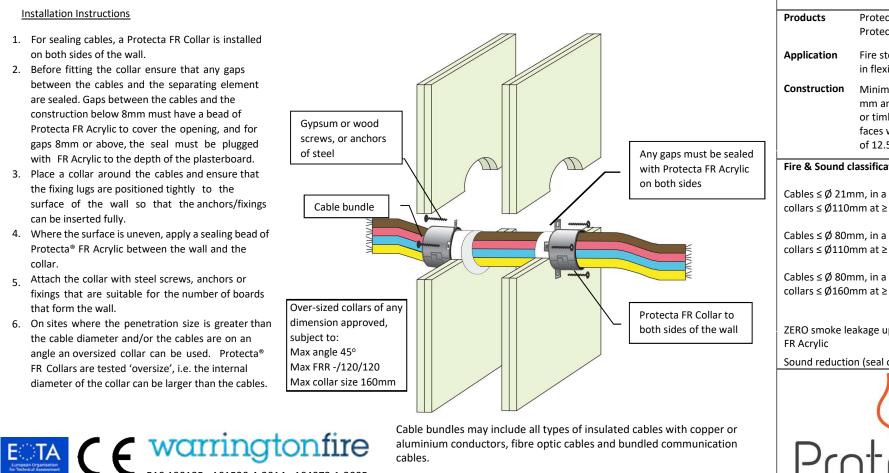

FAS 190125 AS1530.4-2014 AS4072.1-2005

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, is intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

For all technical details on the products specifie please refer to the technical data sheets that ca be found on www.firestopcentre.co.nz

Signed and approved:

	System in A Register 10# 1 C434		
		Protecta FR Collar Protecta FR Acrylic	
		Fire stopping of cable bundles in flexible walls	
	1	Minimum wall thickness of 10 mm and comprise steel studs or timber studs lined on both faces with minimum 2 layers of 12.5 mm thick boards	0
	Fire & Sound classification		
	Cables ≤ Ø 21mm, in a bundle ≤ Ø110mm, with collars ≤ Ø110mm at ≥ 30mm height FRR -/120/60		
	Cables $\leq \emptyset$ 80mm, in a bundle $\leq \emptyset$ 110mm, with collars $\leq \emptyset$ 110mm at $\geq$ 50mm height FRR -/120/60 Cables $\leq \emptyset$ 80mm, in a bundle $\leq \emptyset$ 160mm, with collars $\leq \emptyset$ 160mm at $\geq$ 60mm height		
	collars ≤ Ø160mr	n at ≥ 60mm height FRR -/120 /6	0
	ZERO smoke leakage up to 200Pa with 10mm FR Acrylic		
	Sound reduction	(seal only) STC 5	58
	Protecta		
ed	Polyseam Ltd, 15 St Andrews Road,		
an	Huddersfield, West Yorkshire, HD1 6SB		
	Sheet size:	Drawn date & no:	
	A4	28/7/20	
	Scale:	Drawn by:	
	NTS	K.B	