


Protecta FR Collar - Timber/CLT Wall Plastic Pipes (PE-LD, PE-MD, PE-HD, PEX, PP, PP-MV, PP-H, PP-R) with Combustible (Elastomeric) or Non- combustible Insulation

Installation Instructions

1. For sealing plastic pipes, a pipe collar is installed on both sides of the wall.
2. Before fitting the pipe collar ensure that any gaps between the pipe and the separating element are sealed. Gaps between the pipe and the construction must be plugged with 25mm deep Protecta FR Acrylic on 25mm deep backing of stone-wool (or 50mm FR Acrylic).
3. Place a pipe collar around the service penetration (pipe) and ensure that the fixing lugs are positioned tightly to the surface of the wall so that the 80mm wood screw fixings can be inserted fully.
4. Where the surface is uneven, apply a sealing bead of Protecta® FR Acrylic between the wall and the pipe collar.
5. Annular gap must be minimum 10mm for pipe sizes up to 160mm. Annular gap for larger pipe sizes must be 8-12mm.
6. On sites where the penetration size is greater than the pipe diameter and/or the pipe is on an angle an oversized collar can be used. Protecta® FR Collars are tested 'oversize', i.e. the internal diameter of the collar can be larger than the pipe.

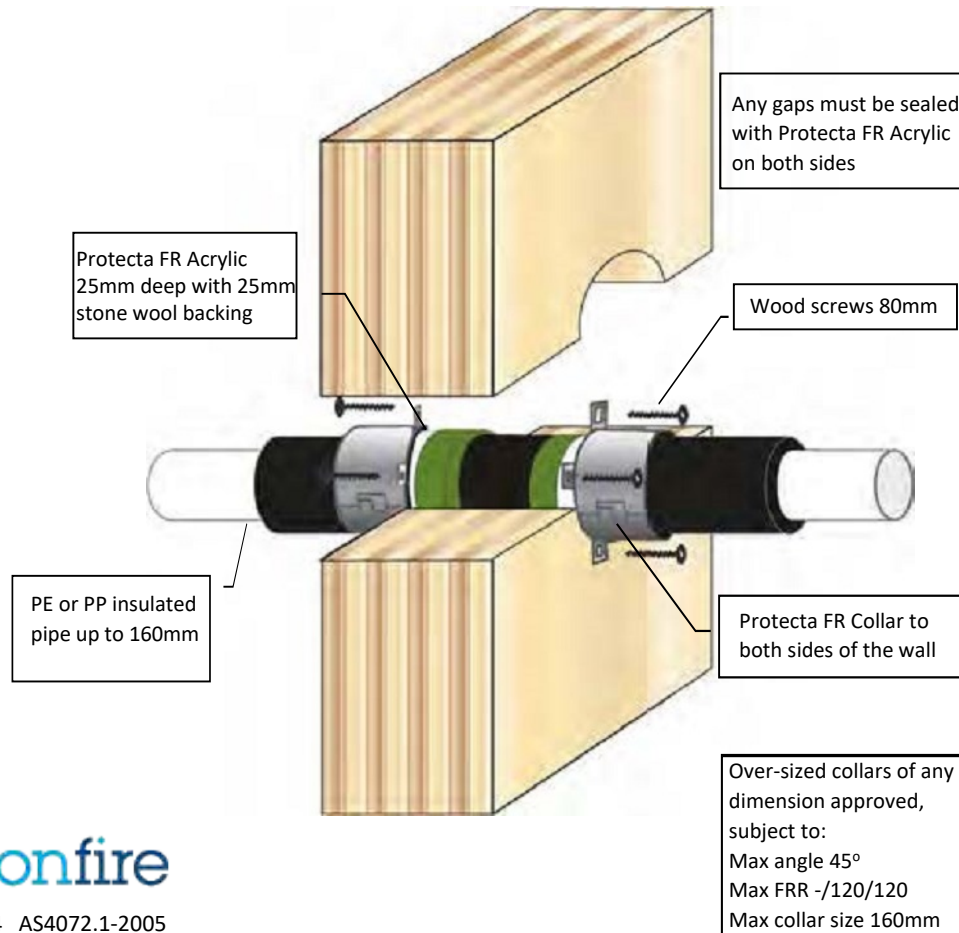

System/FPA Register ID# FC607

Products	Protecta FR Collar Protecta FR Acrylic
Application	Fire stopping of plastic pipes with combustible or non-combustible insulation in timber walls.
Construction	Minimum wall thickness of 100mm and comprise solid wood or cross-laminated timber with min density 510kg/m ³

Fire & Sound classification

Pipe may be PE (including PE-LD, PE-MD, PE-HD, PEX)
or PP (including PP-MV, PP-H, PP-R)
with 9-50mm Elastomeric or non-combustible insulation

For pipes up to 50mm diam with 50mm FR Collar
up to 110mm or 60mm FR Collar up to 200mm
FRR -/90/90

For pipes up to 160mm diam with 75mm FR
Collar up to 315mm
FRR -/120/120

ZERO smoke leakage up to 200Pa

Sound reduction (seal only) STC 58

Sheet size: **A4**
Drawn date & no: 28/7/20

Scale: **NTS**
Drawn by: K.B