



UL INTERNATIONAL (UK) LTD  
 Womersley House, Building C,  
 The Guildway,  
 Old Portsmouth Road,  
 Guildford. GU3 1LR.  
 United Kingdom.



designated according to Article 29 of the Regulation (EU) No 305/2011 and member of EOTA (European Organisation for Technical Assessment, [www.eota.eu](http://www.eota.eu))

## European Technical Assessment

**ETA 17/0695**  
**of 17/11/2017**

**Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: UL International (UK) Ltd**

**Trade name of the construction product**

Protecta FR Service Transit

**Product family to which the construction product belongs**

Fire Stopping and Sealing Product:  
 • Penetration Seals

**Manufacturer**

Polyseam Ltd  
 15 St Andrews Road  
 Huddersfield  
 West Yorkshire  
 HD1 6SB  
 United Kingdom

**Manufacturing plant(s)**

A/003

**This European Technical Assessment contains**

18 pages including 1 Annex which forms an integral part of this assessment.

**This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of**

ETAG 026-2, edition 2011, used as European Assessment Document (EAD).

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

## **Table of Contents**

|   |   |          |
|---|---|----------|
| <b>I.</b>   | <b>SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT .....</b>  | <b>3</b> |
| 1   | Technical description of the product .....  | 3        |
| 2   | Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): ETAG 026-2..... | 3        |
| 3   | Performance of the product and references to the methods used for its assessment .....  | 5        |
| 4   | ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE.....                    | 6        |
| 5   | Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD .....                                  | 6        |
| 6   | Issued on:.....   | 7        |
| <b>ANNEX A – Resistance to Fire Classification – Protecta FR Service Transit.....</b> |   | <b>8</b> |
| A.1   | Flexible or rigid wall constructions with wall thickness of minimum 75 mm .....   | 8        |
| A.1.1   | Penetration seals, in drywalls (min. 1 x 12.5 mm board per side) and concrete/masonry walls.....  | 8        |
| A.2   | Flexible or rigid wall constructions with wall thickness of minimum 100 mm .....  | 10       |
| A.2.1   | Penetration seals, in drywalls (min. 2 x 12.5 mm board per side) and concrete/masonry walls.....  | 10       |
| A.2.2   | Penetration seals, in 100 mm thick Protecta FR Board 1-S seals in drywalls (min. 2 x 12.5 mm board per side) and concrete/masonry walls.....        | 12       |
| A.3   | Rigid walls constructions with wall thickness of minimum 150 mm .....   | 13       |
| A.3.1   | Penetration seals in concrete/masonry walls .....   | 13       |
| A.3.2   | Penetration seals, in 150 mm thick Protecta FR Board 2-S seals (including 30 mm air gap) in concrete/masonry walls .....                            | 15       |
| A.4   | Rigid floor constructions with wall thickness of minimum 150 mm .....   | 16       |
| A.4.1   | Penetration seals in concrete/masonry floors .....  | 16       |
| A.4.2   | Penetration seals, in 50 mm thick Protecta EX Mortar seals (with 50 mm stone wool backer) in concrete/masonry floors .                              | 18       |

## I. SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT

### 1 Technical description of the product

- 1) Protecta FR Service Transit is a cable box device used to form penetration seals where cables and conduits penetrate walls and floors.
- 2) The Protecta FR Service Transit is supplied with intumescent liner complete within a hinged Polypropylene shell, to be closed around the services and inserted into the aperture in the supporting element.
- 3) The applicant has submitted a written declaration that the product and/or constituents of the product contains no substances which have been classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No. 1272/2008 and listed in the 'indicative list on dangerous substances' of the EGDS – taking into account the installation conditions of the construction product and the release scenarios resulting from there.

In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

- 4) The use category of Protecta FR Service Transit in relation to BWR 3 (Hygiene, health and environment) is IA1, S/W3

### 2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): ETAG 026-2

Detailed information and data is given in Annex A.

The intended use of system Protecta FR Service Transit is to reinstate the fire resistance performance of flexible wall and rigid wall and floor constructions, where they are penetrated by services.

- 1) The specific elements of construction that the system Protecta FR Service Transit may be used to provide a penetration seal in, are as follows:

Flexible walls: The wall must have a minimum thickness of 75 mm and comprise steel studs lined on both faces with minimum 1 layer of 12.5 mm thick boards.

Rigid walls: The wall must have a minimum thickness of 75 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m<sup>3</sup>.

Rigid floors: The floor must have a minimum thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 650 kg/m<sup>3</sup>.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

- 2) The system Protecta FR Service Transit may be used to provide a penetration seal with specific supporting constructions and substrates (for details see Annex A).

- 3) The provisions made in this European Technical Assessment are based on an assumed working life of the Protecta FR Service Transit of 30 years, provided that the conditions laid down in the manufacturers datasheet and instructions for the packaging/transport/storage/installation/use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.
- 4) Type Z<sub>2</sub>: intended for use at internal conditions with humidity classes other than Z<sub>1</sub>, excluding temperatures below 0°C.

**3 Performance of the product and references to the methods used for its assessment**

|  |  |  |
|--|--|--|
| Product-type: Pipe Service Transit                 |  | Intended use: Penetration Seal                           |
| Basic requirement for construction work            | Basic Requirement                      | Performance  |
| <b>BWR 1 Mechanical resistance and stability</b>   |  |  |
| -  | None                                   | Not relevant   |
| <b>BWR 2 Safety in case of fire</b>                |  |  |
| EN 13501-1   | Reaction to fire                       | Performance not assessed                                 |
| EN 13501-2   | Resistance to fire                     | Annex A  |
| <b>BWR 3 Hygiene, health and environment</b>       |  |  |
| EN 1026:2000                                       | Air permeability (material property)   | No performance determined                                |
| ETAG 026-2, Annex C                                | Water permeability (material property) | No performance determined                                |
| Declaration of manufacturer                        | Release of dangerous substances        | Use categories: IA1, S/W3<br>Declaration of manufacturer |
| <b>BWR 4 Safety in use</b>                         |  |  |
| EOTA TR 001:2003                                   | Mechanical resistance and stability    | No performance determined                                |
| EOTA TR 001:2003                                   | Resistance to impact/movement          | No performance determined                                |
| EOTA TR 001:2003                                   | Adhesion                               | No performance determined                                |
| <b>BWR 5 Protection against noise</b>              |  |  |
| EN 10140-2/ EN ISO 717-1                           | Airborne sound insulation              | No performance determined                                |
| <b>BWR 6 Energy economy and heat retention</b>     |  |  |
| EN 12664, EN 12667 or EN 12939                     | Thermal properties                     | No performance determined                                |
| EN ISO 12572<br>EN 12086                           | Water vapour permeability              | No performance determined                                |
| <b>General aspects relating to fitness for use</b> |  |  |
| EOTA TR 024:2009, clause 3.1.11 & 3.1.12           | Durability and serviceability          | Z <sub>2</sub>   |
| <b>BWR 7 Sustainable use of natural resources</b>  |  |  |
| -  | -                                      | No performance determined                                |

**4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE**

According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, see <http://eur-lex.europa.eu/JOIndex.do> of the European Commission<sup>1</sup>, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

| <b>Product(s)</b>                       | <b>Intended use(s)</b>   | <b>Level(s) or class(es)</b> | <b>System(s)</b> |
|---|--|------------------------------|------------------|
| Fire stopping and Fire Sealing Products | For fire compartmentation and/or fire protection or fire performance | Any                          | 1                |

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD**

Tasks of the manufacturer:

Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall ensure that the product is in conformity with this European Technical Assessment.

The manufacturer may only use initial / raw / constituent materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the Control Plan of 6<sup>th</sup> May 2014 relating to the European Technical Assessment ETA 17/0695 issued on 17/11/17 which is part of the technical documentation of this European Technical Assessment. The "Control Plan" is laid down in the context of the factory production control system operated by the manufacturer and deposited at UL International (UK) Ltd.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the Control Plan.

---

<sup>1</sup> Official Journal of the European Communities L178/52 of 14/7/1999

Other tasks of the manufacturer

Additional information

The manufacturer shall provide a technical data sheet and an installation instruction with the following minimum information:

(a) Technical data sheet:

- Field of application:
- Building elements for which the penetration seal is suitable, type and properties of the building elements like minimum thickness, density, and - in case of lightweight constructions – the construction requirements.
- Limits in size, minimum thickness etc. of the penetration seal
- Construction of the penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.

(b) Installation instruction:

- Steps to be followed
- Procedure in case of retrofitting
- Stipulations on maintenance, repair and replacement

**6 Issued on:**

**17<sup>th</sup> November 2017**

Report by:



C. Johnson  
Staff Engineer  
Building and Life Safety Technologies

Reviewed by:



C. W. Miles  
Business Manager – Europe & Latin America  
Building and Life Safety Technologies

**For and on behalf of UL International (UK) Ltd.**



# ANNEX A – Resistance to Fire Classification – Protecta FR Service Transit

## A.1 Flexible or rigid wall constructions with wall thickness of minimum 75 mm


### A.1.1 Penetration seals, in drywalls (min. 1 x 12.5 mm board per side) and concrete/masonry walls

**Penetration Seal:** Cables and conduits fitted with 150 mm long Protecta FR Service Transit, central within the wall. Spaces around cables and conduits within the device are sealed with 50 mm deep Mineral Bio Wool installed centrally. Min. Separation between seals ( $a_2$ ) = 30 mm, min. Separation between seals ( $a_2$ ) = 30 mm, min. Separation between transit and supporting construction ( $a_1$ ) = 0 mm.


Construction details:

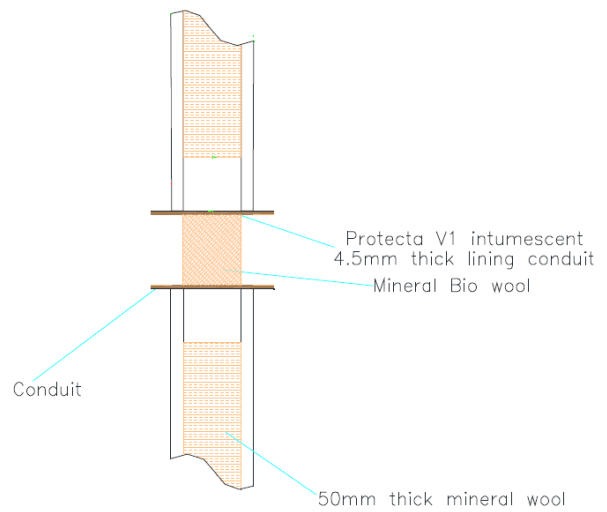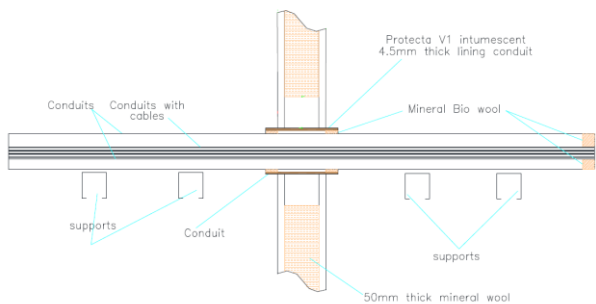

Option 1

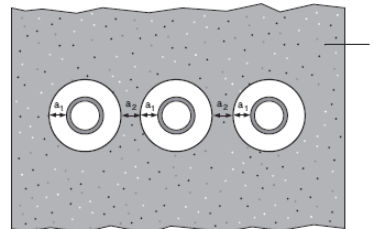

Option 2

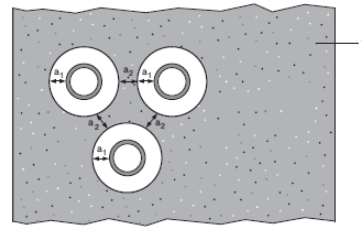

**Key**

- 1 Supporting construction
- $a_1$  Pipe / edge of seal separation (annular space)
- $a_2$  Separation between penetration seals

Figure E.2 — Standard configuration for single pipe penetration seals




### A.1.1.1

| Services   | Inlay size                      | Transit size                      | Classification              |
|--|---------------------------------|-----------------------------------|-----------------------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 150 mm long     | 40 mm Ø x 150 mm long             | <b>EI 60</b>                |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 150 mm long     | 63 mm Ø x 150 mm long             |                             |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 150 mm long     | 90 mm Ø x 150 mm long             |                             |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 150 mm long     | 110 mm Ø x 150 mm long            |                             |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above | <b>E 60</b><br><b>EI 30</b> |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                   | <b>EI 60 U/C</b>            |

**A.2 Flexible or rigid wall constructions with wall thickness of minimum 100 mm**

**A.2.1 Penetration seals, in drywalls (min. 2 x 12.5 mm board per side) and concrete/masonry walls**

**Penetration Seal:** Cables and conduits fitted with 250 mm long Protecta FR Service Transit, central within the wall. Spaces around cables and conduits within the device are sealed with 50 mm deep Mineral Bio Wool installed centrally. Min. Separation between seals ( $a_2$ ) = 30 mm, min. Separation between transit and supporting construction ( $a_1$ ) = 0 mm A.2.1.1 and minimum 10 mm with maximum aperture 300 x 300mm A.2.1.2.

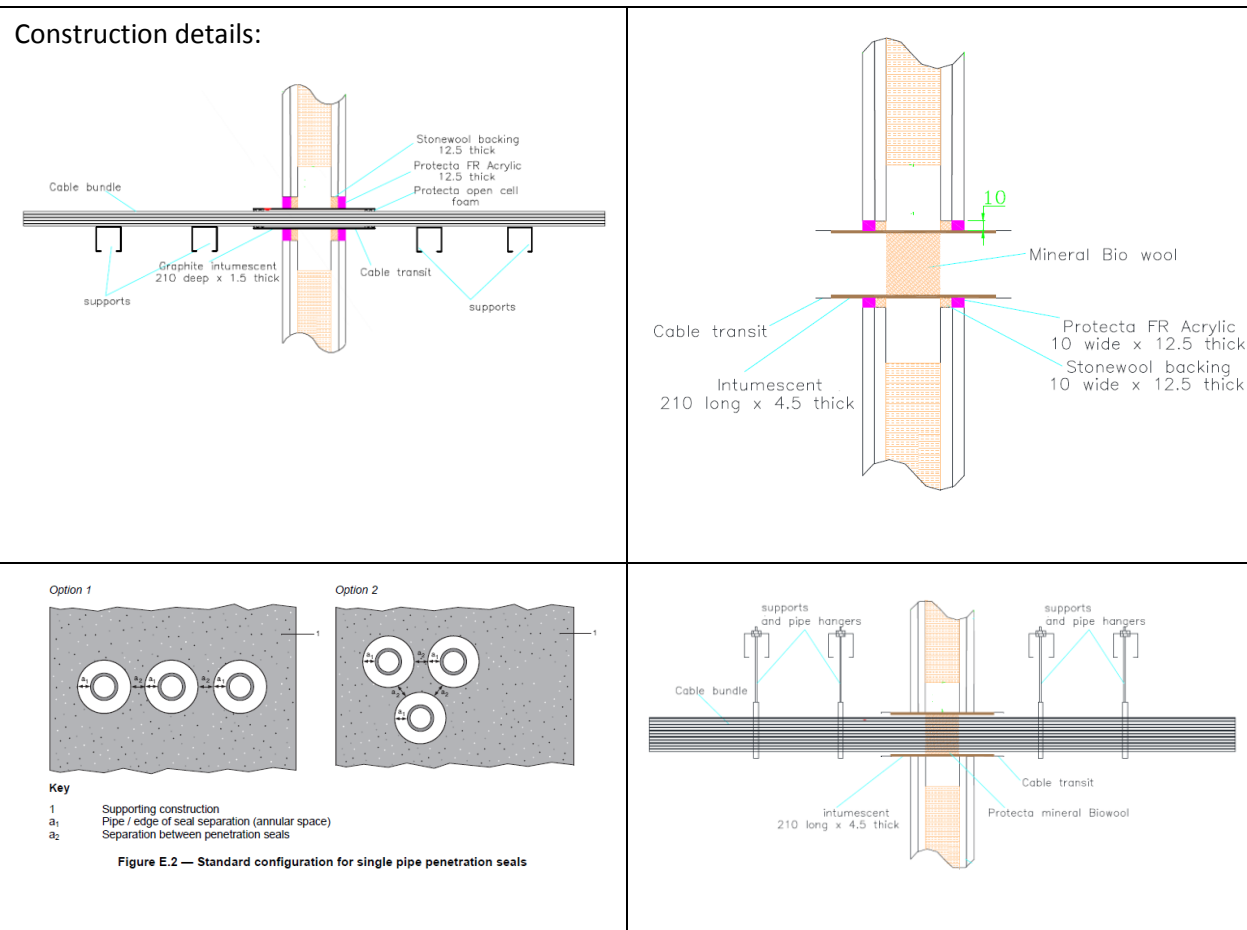

### A.2.1.1 – FR Service transit friction fitted into wall

| Services   | Inlay size                      | Transit size                      | Classification |
|--|---------------------------------|-----------------------------------|----------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm Ø x 250 mm long             | EI 90          |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm Ø x 250 mm long             |                |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm Ø x 250 mm long             |                |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm Ø x 250 mm long            |                |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above | E 90<br>EI 60  |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                   | EI 90 U/C      |

### A.2.1.2 – FR Service Transit in minimum 20 mm oversize aperture fitted with Protecta FR Acrylic.

| Services   | Inlay size                      | Transit size                      | Classification |
|--|---------------------------------|-----------------------------------|----------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm Ø x 250 mm long             | EI 90          |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm Ø x 250 mm long             |                |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm Ø x 250 mm long             |                |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm Ø x 250 mm long            |                |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above | EI 90          |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                   | EI 90 U/C      |

**A.2.2 Penetration seals, in 100 mm thick Protecta FR Board 1-S seals in drywalls (min. 2 x 12.5 mm board per side) and concrete/masonry walls**

**Penetration Seal:** Cables and conduits fitted with 250 mm long Protecta FR Service Transit, central within the seal. Spaces around cables and conduits within the device are sealed with 50 mm deep Mineral Bio Wool installed centrally. Min. Separation between transits and between transits and the edges of the board seal ( $a_1$ ,  $a_2$ ,  $a_3$ ) = 30 mm, min.

Construction details:

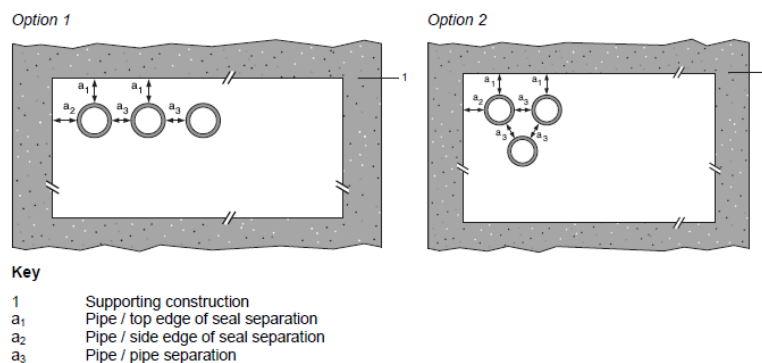
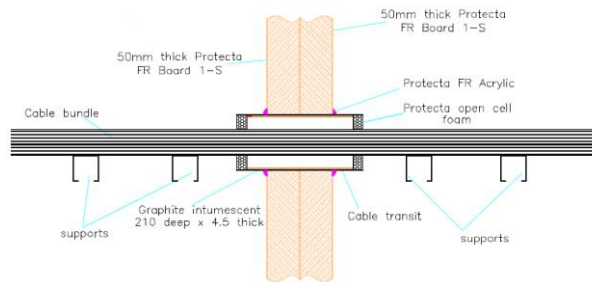


Figure E.1 — Standard configuration for multiple pipe penetration seals

**A.2.2.1**




| Services   | Inlay size                      | Transit size                       | Classification |
|--|---------------------------------|------------------------------------|----------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm $\varnothing$ x 250 mm long  | EI 90          |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm $\varnothing$ x 250 mm long  |                |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm $\varnothing$ x 250 mm long  |                |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm $\varnothing$ x 250 mm long |                |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above  | E 90<br>EI 60  |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                    | EI 90 U/C      |

### A.3 Rigid walls constructions with wall thickness of minimum 150 mm

#### A.3.1 Penetration seals in concrete/masonry walls


**Penetration Seal:** Cables and conduits fitted with 250 mm long Protecta FR Service Transit, central within the wall. Spaces around cables and conduits within the device are sealed with 50 mm deep Mineral Bio Wool installed centrally. Min. Separation between seals ( $a_2$ ) = 30 mm, min. Separation between transit and supporting construction ( $a_1$ ) = 0 mm A.3.1.1 and minimum 10 mm with maximum aperture 300 x 300mm A.3.1.2.

##### Construction details:

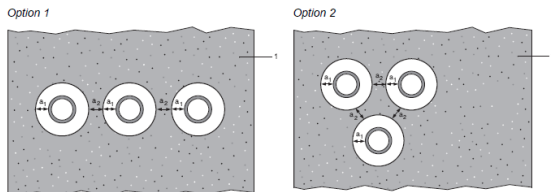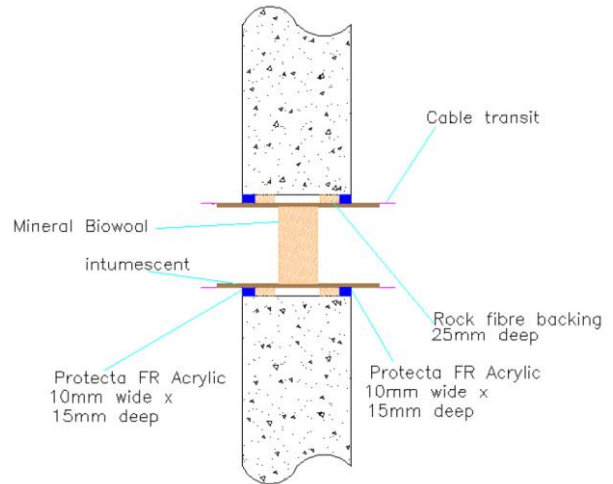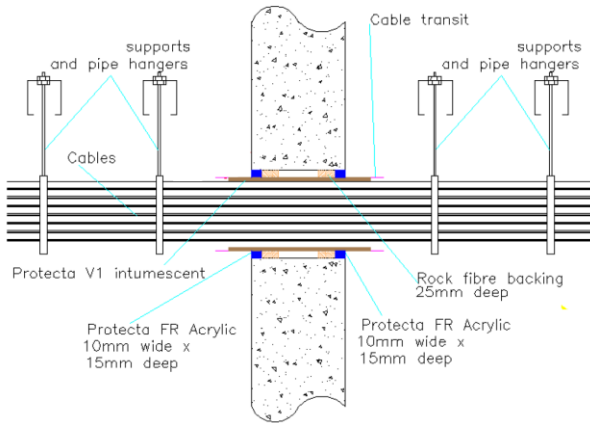

**Key**  
 1 Supporting construction  
 $a_1$  Pipe / edge of seal separation (annular space)  
 $a_2$  Separation between penetration seals

Figure E.2 — Standard configuration for single pipe penetration seals

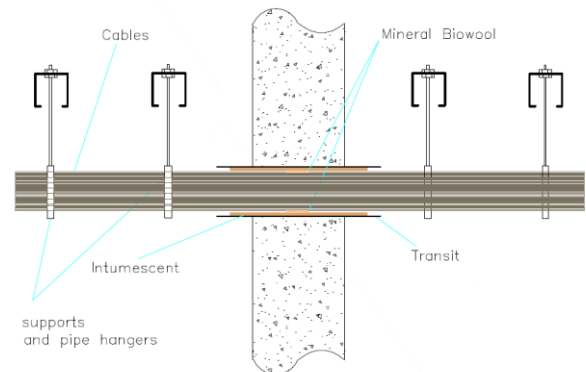

### A.3.1.1 – FR Service Transit friction fitted into wall



| Services   | Inlay size                      | Transit size                      | Classification  |
|--|---------------------------------|-----------------------------------|-----------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm Ø x 250 mm long             | EI 240          |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm Ø x 250 mm long             |                 |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm Ø x 250 mm long             |                 |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm Ø x 250 mm long            | E 240<br>EI 180 |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above | E 240<br>EI 90  |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                   | EI 240 U/C      |

### A.3.1.2 – FR Service Transit in minimum 20 mm oversize aperture fitted with Protecta FR Acrylic.

| Services   | Inlay size                      | Transit size                      | Classification  |
|--|---------------------------------|-----------------------------------|-----------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm Ø x 250 mm long             | EI 240          |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm Ø x 250 mm long             |                 |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm Ø x 250 mm long             |                 |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm Ø x 250 mm long            | E 240<br>EI 180 |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above | E 240<br>EI 90  |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                   | EI 240 U/C      |

### A.3.2 Penetration seals, in 150 mm thick Protecta FR Board 2-S seals (including 30 mm air gap) in concrete/masonry walls

**Penetration Seal:** Cables and conduits fitted with 250 mm long Protecta FR Service Transit, central within the seal. Spaces around cables and conduits within the device are sealed with 50 mm deep Mineral Bio Wool installed centrally. Min. Separation between transits and between transits and the edges of the board seal ( $a_1, a_2, a_3$ ) = 30 mm, min.

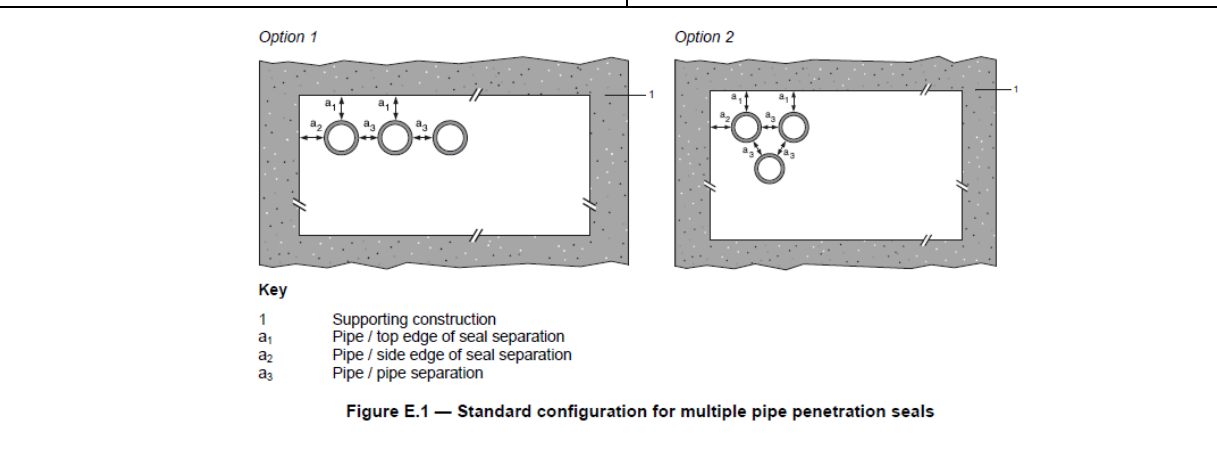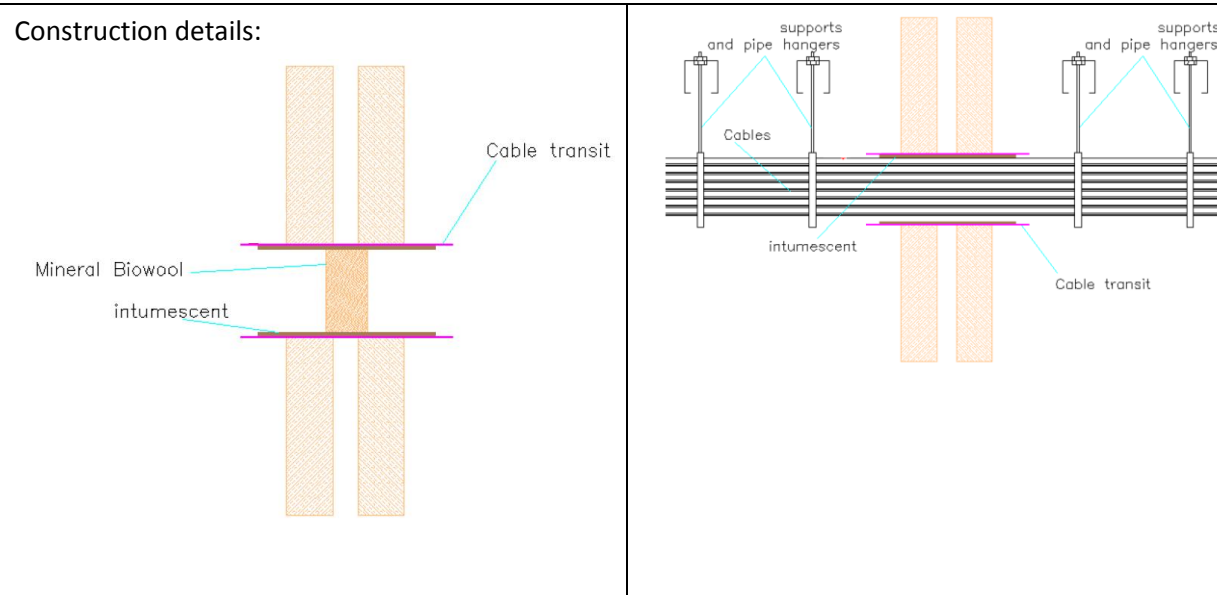

#### A.3.2.1



| Services   | Inlay size                      | Transit size                       | Classification                |
|--|---------------------------------|------------------------------------|-------------------------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm $\varnothing$ x 250 mm long  | <b>E 240</b><br><b>EI 180</b> |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm $\varnothing$ x 250 mm long  |                               |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm $\varnothing$ x 250 mm long  | <b>E 180</b><br><b>EI 120</b> |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm $\varnothing$ x 250 mm long | <b>E 240</b><br><b>EI 120</b> |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above  | <b>E 240</b><br><b>EI 90</b>  |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                    | <b>EI 90 U/C</b>              |

## A.4 Rigid floor constructions with thickness of minimum 150 mm


### A.4.1 Penetration seals in concrete/masonry floors

**Penetration Seal:** Cables and conduits fitted with 250 mm long Protecta FR Service Transit, central within the floor. Spaces around cables and conduits within the device are sealed with 50 mm deep Mineral Bio Wool installed centrally. Min. Separation between seals ( $a_2$ ) = 30 mm, min. Separation between transit and supporting construction ( $a_1$ ) = 0 mm A.4.1.1 and minimum 10 mm with maximum aperture 300 x 300mm A.4.1.2.


Construction details:

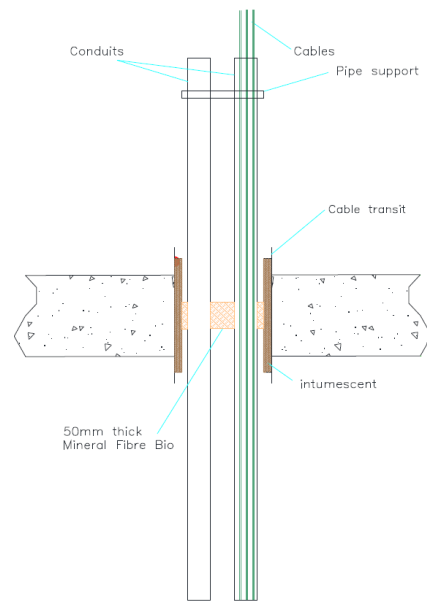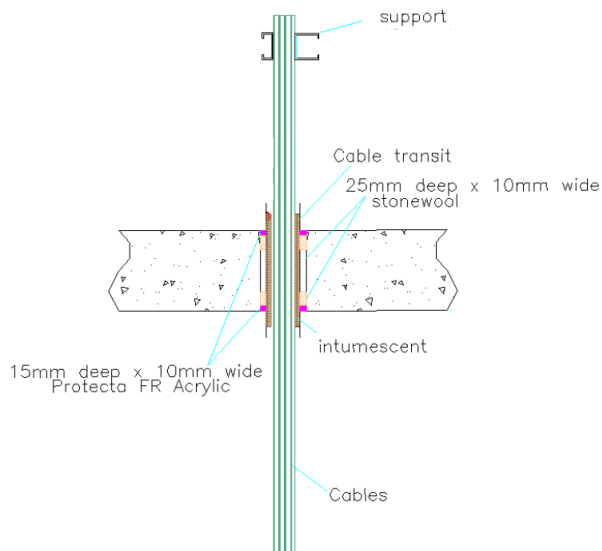

Option 1

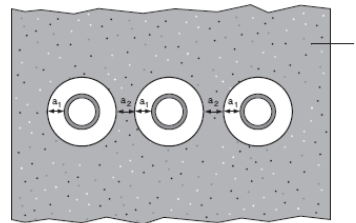

Option 2

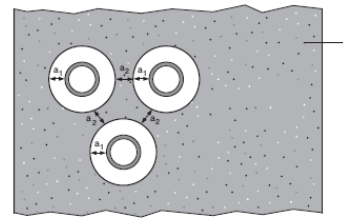

Key

- 1 Supporting construction
- $a_1$  Pipe / edge of seal separation (annular space)
- $a_2$  Separation between penetration seals

Figure E.2 — Standard configuration for single pipe penetration seals



#### A.4.1.1 – FR Service transit friction fitted into floor



| Services   | Inlay size                      | Transit size                      | Classification                       |
|--|---------------------------------|-----------------------------------|--------------------------------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm Ø x 250 mm long             | <b>EI 180</b>                        |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm Ø x 250 mm long             |                                      |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm Ø x 250 mm long             |                                      |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm Ø x 250 mm long            |                                      |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above | <b>E 240</b><br><b>EI 180</b>        |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                   | <b>E 120 C/U</b><br><b>EI 60 C/U</b> |

#### A.4.1.2 – FR Service Transit in minimum 20 mm oversize aperture fitted with Protecta FR Acrylic.

| Services   | Inlay size                      | Transit size                      | Classification                       |
|--|---------------------------------|-----------------------------------|--------------------------------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm Ø x 250 mm long             | <b>EI 240</b>                        |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm Ø x 250 mm long             | <b>E 240</b><br><b>EI 180</b>        |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm Ø x 250 mm long             | <b>EI 240</b>                        |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm Ø x 250 mm long            | <b>EI 180</b>                        |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above | <b>E 240</b><br><b>EI 180</b>        |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                   | <b>E 120 C/U</b><br><b>EI 60 C/U</b> |

#### A.4.2 Penetration seals, in 50 mm thick Protecta EX Mortar seals (with 50 mm stone wool backer) in concrete/masonry floors

**Penetration Seal:** Cables and conduits fitted with 250 mm long Protecta FR Service Transit, central within the seal. Spaces around cables and conduits within the device are sealed with 50 mm deep Mineral Bio Wool installed centrally. Min. Separation between transits and between transits and the edges of the board seal ( $a_1, a_2, a_3$ ) = 30 mm, min.

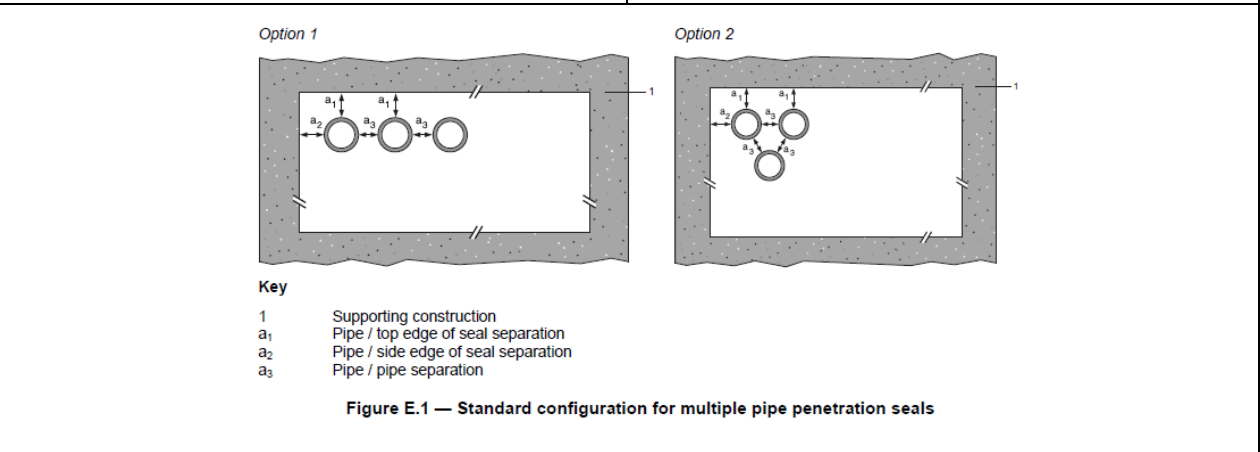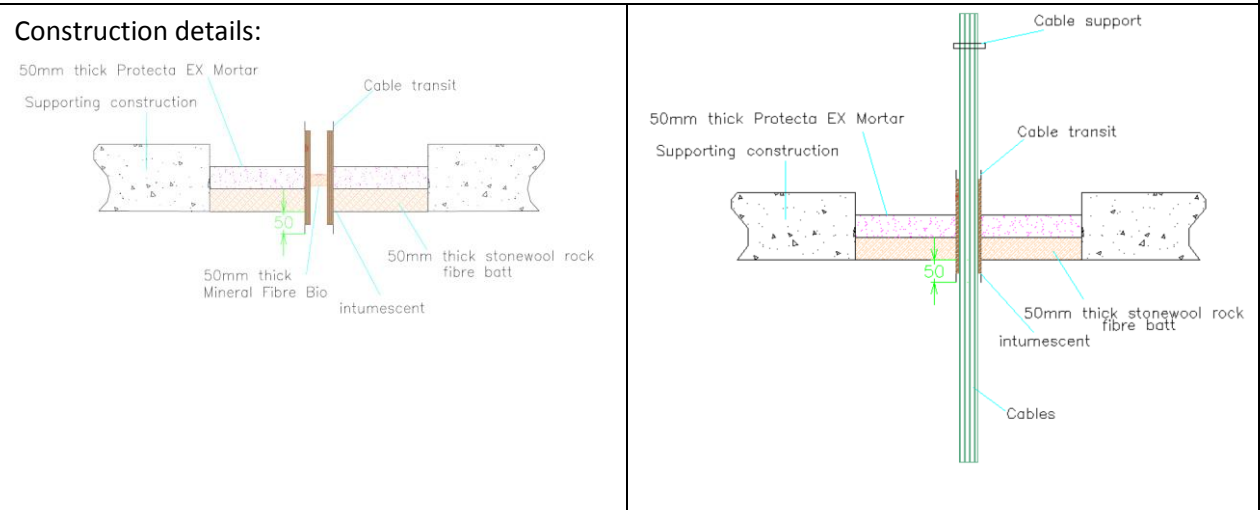

##### A.4.2.1

| Services   | Inlay size                      | Transit size                       | Classification         |
|--|---------------------------------|------------------------------------|------------------------|
| Up to 35 mm diameter bundle of cables up to 14 mm diameter   | 1.5 mm thick by 210 mm long     | 40 mm $\varnothing$ x 250 mm long  | EI 240                 |
| Up to 50 mm diameter bundle of cables up to 14 mm diameter   | 2.0 mm thick by 210 mm long     | 63 mm $\varnothing$ x 250 mm long  | EI 180                 |
| Up to 80 mm diameter bundle of cables up to 14 mm diameter   | 4.0 mm thick by 210 mm long     | 90 mm $\varnothing$ x 250 mm long  | E 240<br>EI 120        |
| Up to 100 mm diameter bundle of cables up to 14 mm diameter  | 4.5 mm thick by 210 mm long     | 110 mm $\varnothing$ x 250 mm long | EI 120                 |
| Empty filled at mid-depth with 50 mm deep plug of Mineral Bio Wool   | All inlay sizes specified above | All transit sizes specified above  | E 240<br>EI 180        |
| Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter |                                 |                                    | E 120 C/U<br>EI 60 C/U |